

December 13, 2021

## **ADDENDUM NO. 1**

### **TO PROSPECTIVE BIDDERS UNDER RFQ NO. 2205, “ORINDA WTP SIPHON”**


Notice is hereby given that RFQ No. 2205 of the East Bay Municipal Utility District has been revised as set forth below:

1. EXHIBIT E TECHNICAL SPECIFICATIONS, DRAWINGS, AND FORMS - **Add paragraph below** on page 12, SECTION 05 12 00 (STRUCTURAL STEEL), PART 3.C. Welding: General.

“3. Partial Joint Penetration (PJP) welds are acceptable where fillet and Complete Joint Penetration (CJP) welds are not accessible from inside the siphon. PJP welds can be single-V-groove or single -bevel-groove welds with a minimum Effective Throat (E) of 70 percent of the minimum plate thickness being welded, and the Root (R) opening shall be zero (0).”

**THIS ADDENDUM MUST BE SUBMITTED WITH THE BID.**

Thank you for your cooperation.

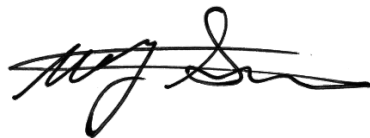

Kelley K. Smith  
Manager of Purchasing